

2010 EDITION


PROTECTO 401™

CERAMIC EPOXY LINED DUCTILE IRON PIPE AND FITTINGS


FOR FORCE MAINS, GRAVITY AND INDUSTRIAL SEWER LINES

MORE
THAN
JUST
PIPE.



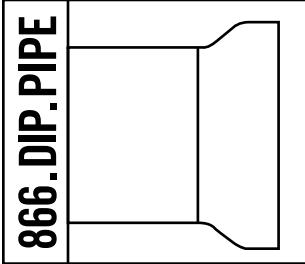

PROTECTO 401™




2010 EDITION

P 2

Table of Contents

PROTECTO 401	3
Suggested Specification For PROTECTO 401	5
Procedures for Sealing and Repairing	8
Technical Data	9
Products for Water, Waste Water and Fire Protection	10



PROTECTO 401™

2010 EDITION

P 3

PROTECTO 401

Gray iron pipe preceded Ductile Iron pipe by well over 100 years. Its intended use was to convey water as well as wastewater. Continuous tests and field experience have brought the production and use of Ductile Iron pipe to maturity. It has replaced gray iron pipe in practically all applications. Ductile Iron is a high strength, tough material used in water and sewer systems in all states within the U.S. and in many other areas of the world. Because of this inherent strength, U.S. Ductile Iron pipe is ideally suited to deep buries prevalent in gravity sewer systems. In addition to the elimination of infiltration/exfiltration, TR FLEX® Pipe and Fittings and FIELD LOK 350® Gaskets used with TYTON JOINT® Pipe will provide restraint to prevent joint separation.


U.S. Pipe's PROTECTO 401 Lined Ductile Iron Pipe and Fittings provide excellent protection and the strength necessary to do the job in tough sewer pipe applications. PROTECTO 401 has been successfully used in thousands of sanitary sewer applications and has been proven with both laboratory testing and two decades of actual sewer service on all sizes of Ductile Iron pipe and fittings.

PROTECTO 401 Ceramic Epoxy Lining was designed specifically for protection of Ductile Iron for sanitary sewer service by providing a reliability similar to cement mortar lining in drinking water service but having the excellent chemical resistance of a novalac epoxy for septic sewer service. Easily recognized brownish red bells and spigots, as well as stenciling showing "for sewer only", ensure that the correct lined pipe is used for sewer service. This concentration of design and formulation effort has resulted in a Ductile Iron pipe lining system with excellent durability, resistance to undercutting, and resistance to chemical attack.

PROTECTO 401 Ceramic Epoxy Lined Ductile Iron Pipe may be diametrically deflected up to 5% without damage to either the pipe or the lining



TR FLEX® & FIELD LOK 350® are Registered Trademarks of U.S. Pipe and Foundry Company.



Protecto 401(cont.)

PROTECTO 401 Has Been Tested And Withstood The Following:

Salt Spray

Two years with no undercutting on a scribed Ductile Iron panel when measured using ASTM B 117 and when rated using ASTM D 714 evaluating degrees of blistering.

20% Sulfuric Acid

Two years with no effect when rated using ASTM D 714 evaluating degree of blistering.

25% Sodium Hydroxide Immersion

At 140°F two years with no effect when rated using ASTM D 714 evaluating degree of blistering.

Distilled Water Immersion

At 160°F two years with no effect when rated using ASTM D 714 evaluating degree of blistering.

Abrasion Resistance


Less than .075mm (3 mils) loss after one million cycles on a plus 22.5° to minus 22.5° sliding aggregate slurry abrasion tester using a sharp natural siliceous gravel with a particle size between 2 mm and 10 mm. This text conforms with European Standard EN598, Section 7.8.

PROTECTO 401 is also resistant to a wide range of oils, greases, solvents, detergents and fuels which may be introduced into a sewer line.

PROTECTO 401 is applied to the interior of Ductile Iron pipe and fittings utilizing specialized application equipment and a stringent specification. The lining is designed to be applied at a nominal 40 mils thickness. A non-destructive pinhole detection test and a thickness test are performed to ensure a sound, chemically resistant protective lining for U.S. Pipe's Ductile Iron pipe and fittings.

PROTECTO 401 is intended for use in domestic sanitary sewage lines. Chemical injection for odor control may damage pipe, gaskets and/or protective linings. Requests for individual recommendations for industrial sewer applications of PROTECTO 401 Lined Pipe and Fittings should be made to a U.S. Pipe Sales Representative.

NOTE: Contact your U.S. Pipe Sales Representative for special guidelines if field welding is required.



Suggested Specification For PROTECTO 401 Interior Lining For Ductile Iron Pipe And Fittings

I. Condition Of Ductile Iron Prior To Surface Preparation

All Ductile Iron pipe and fittings shall be delivered to the application facility without asphalt, cement lining, or any other lining on the interior surface. Because complete removal of old linings may not be possible, the intent of this specification is that the entire interior of the Ductile Iron pipe and fittings shall not have been lined with any substance prior to the application of the specified lining material and no coating shall have been applied to the first six inches of the exterior of the spigot ends.

II. Lining Material

The standard of quality is PROTECTO 401 Ceramic Epoxy. The material shall be an amine cured novalac epoxy containing at least 20% by volume of ceramic quartz pigment. Any request for substitution must be accompanied by a successful history of lining pipe and fittings for sewer service, a test report verifying the following properties and a certification of the test results.

A. A permeability rating of 0.00 when tested according to the procedure described in Method A of ASTM E 96, Procedure A with a test duration of 30 days.

B. The following tests must be run on coupons from factory lined Ductile Iron pipe.

1. ASTM B 117 Salt Spray (scribed panel)

Results to equal 0.0 undercutting after two years.

2. ASTM G 95 Cathodic Disbondment (1.5 volts at 77°F)

Results to equal no more than 0.5 mm undercutting after 30 days.

3. Immersion Testing

Rated using ASTM D 714.

a. 20% Sulfuric Acid

No effect after two years.

b. 140°F 25% Sodium Hydroxide

No effect after two years.

c. 160°F Distilled Water (scribed panel)

No effect after two years.


d. 120°F Tap Water (scribed panel)

0.0 undercutting after two years with no effect.

C. Abrasion Resistance

Less than .075 mm (3 mils) loss after one million cycles on a $\pm 22.5^\circ$ sliding aggregate slurry abrasion tester using a sharp natural siliceous gravel with a particle size between 2 mm and 10 mm (European Standard SN598).

NOTE: Contact your U.S. Pipe Sales Representative for special guidelines if field welding is required.



Suggested Specification For PROTECTO 401 Interior Lining For Ductile Iron Pipe And Fittings (cont.)

III. Application

A. Applicator

The lining shall be applied by a certified firm with a successful history of applying linings to the interior of Ductile Iron pipe and fittings.

B. Surface Preparation

Prior to abrasive blasting, the entire area to receive the protective compound shall be inspected for oil, grease, etc. Any areas where oil or grease is present, or any substance which can be removed by solvent, shall be solvent cleaned to remove these substances. After the surface has been made free of grease, oil or other substances, all areas to receive the protective compounds shall be abrasive blasted using compressed air nozzles with sand or grit abrasive material. The entire surface to be lined shall be struck with the blast media so that all rust, loose oxides, etc., are removed from the surface. Only slight stains and tightly adhering oxide may be left on the surface. Any area where rust reappears before lining must be reblasted.

C. Lining

After surface preparation, the interior of the pipe shall receive 40 mils nominal dry film thickness of PROTECTO 401. No lining shall be applied when the substrate or ambient temperature is below 40°F. The surface also must be dry and dust free. If flange pipe or fittings are included in the project, the lining shall not be used on the face of the flange.

D. Coating of Bell Sockets and Spigot Ends

Due to the tolerances involved, bell interior and spigot exterior up to 6 inches back from the end of the spigot end must be coated with 6 mils nominal, 10 mils maximum PROTECTO Joint Compound. The Joint Compound shall be applied by brush to ensure coverage. Care should be taken that the Joint Compound is smooth without excess buildup in the gasket seat or on the spigot ends. Coating of the gasket seat and spigot ends shall be done after the application of the linings.


E. Number of Coats

The number of coats of lining material applied shall be as recommended by the lining manufacturer. However, in no case shall this material be applied above the dry thickness per coat recommended by the lining manufacturer in printed literature. The maximum or minimum time between coats shall be that time recommended by the lining material manufacturer. No material shall be used for lining which is not indefinitely recoatable with itself without roughening of the surface.

F. Touch-Up & Repair

PROTECTO Joint Compound shall be used for touch-up or repair in accordance with manufacturer's recommendations.

NOTE: Contact your U.S. Pipe Sales Representative for special guidelines if field welding is required.



Suggested Specification For PROTECTO 401 Interior Lining For Ductile Iron Pipe And Fittings (cont.)

G. High Pressure Cleaning

Guidelines for Pressure Cleaning The Internal Diameter of Ductile Iron Pipe

The Ductile Iron Pipe Research Association (and its Member Companies), Federal Signal Corporation (and its subsidiaries Vactor, Elgin, Guzzler, Jetstream & Ravo), and Induron Coatings Inc. participated in a pressure cleaning research program which was conducted by the Missouri University of Science and Technology – High Pressure Waterjet Laboratory.

The test program included asphaltic seal coated cement-mortar lined and Protecto 401 lined ductile iron pipe which resulted in guidelines for the pressure cleaning of the inside diameters of ductile iron pipe. Through a collaborative effort with the organizations above and the City of Moline, Illinois, field tests were conducted and the guidelines verified as effective and safe for cement-mortar and Protecto 401 lined ductile iron pipe.

Guidelines are as follows:


1. The nozzle shall be configured with fan jets only (no round jets).
2. The fan jets should be oriented at a maximum angle of 30 degrees to the pipe wall.
3. The nozzle shall be a minimum of 2-inches standoff from the pipe surface.
4. The nozzle assembly shall be self-rotating and incorporate a rotational control mechanism - target speed of 30 rpm.
5. The water pressure at the nozzles shall be no more than 1,800 psi.
6. The nozzle assembly shall have non-abrasive wheels and/or UHMW (ultra-high molecular weight) polyethylene skids positioned so that at no time does the nozzle assembly contact the lining of the pipe.
7. The nozzle assembly shall continually move when pressure washing with no hesitation in the pipe.
8. All hose couplings, hoses, etc. shall be smooth so as to facilitate movement across the pipe joints without creating damage to the lining.

Pipe diameters of 24-inch and larger may require additional passes for effective cleaning.

Vactor Blue Twister Nozzle (or equal) and appropriate assembly

Although research shows no significant damage in testing, the decision to pressure wash, if made by the customer, engineer, or installer, may present some risk of damage to the Protecto 401.

Any such risk is dependent on water pressure, speed, jet design and angle to the lining, distance of the jet from the lining, type of lining, and other factors. DIPRA does not warrant or guarantee the result or assume any risk associated with pressure washing.



Suggested Specification For PROTECTO 401 Interior Lining For Ductile Iron Pipe And Fittings (cont.)

IV. Inspection And Certification

A. Inspection

1. All Ductile Iron pipe and fitting linings shall be checked for thickness using a magnetic film thickness gauge. The thickness testing shall be done using the method outlined in SSPC PA-2 Film Thickness Rating.
2. The interior lining of all pipe and barrels and fittings shall be tested for pinholes with a nondestructive 2,500 volt test. Any defects found shall be repaired prior to shipment.
3. Each pipe joint and fitting shall be marked with the date of application of the lining system along with its numerical sequence of application on that date and records maintained by the applicator of his work.


B. Certification

The pipe or fitting manufacturer must supply a certificate attesting to the fact that the applicator met the requirements of this specification and that the material used was as specified.

C. Handling

PROTECTO 401 Lined Pipe and Fittings must be handled only from the outside of the pipe and fittings. No forks, chains, straps, hooks, etc. shall be placed inside the pipe and fittings for lifting, positioning, or laying.

Note: Contact your U.S. Pipe Sales Representative for special guidelines if field welding is required.




Procedures for Sealing and Repairing

Procedures For Sealing Cut Ends And Repairing Field Damaged Areas of PROTECTO 401 Lined Pipe And Fittings

1. Remove burrs caused by field cutting of ends or handling damage and smooth out the edge of the lining if rough.
2. Remove all traces of oil, grease, asphalt, dust, dirt, etc.
3. Remove any damaged lining caused by field cutting operations or handling and clean any exposed metal by sanding or scraping. Sandblasting or power tool cleaning roughening is also acceptable. It is recommended that any loose lining be removed by chiseling, cutting or scraping into well adhered lined area before patching. Be sure to overlap at least one inch of lining in the area to be repaired.
4. With the area to be sealed or repaired absolutely clean and suitably roughened, apply a coat of PROTECTO Joint Compound using the following procedure.
 - a. **Mixing Procedure** — The repair kit for PROTECTO 401 contains two small cans of PROTECTO Joint Compound. PROTECTO Joint Compound is a two component epoxy and the contents of the small container shall be mixed with the contents of the large container. If less than the full contents of each can is to be mixed, the material may be mixed using the mixing ratio printed on the labels. After Part B is added to Part A, the mixture shall be thoroughly agitated. All activated material must be used within one hour of mixing.
 - b. **Application of Material** — After the material has been thoroughly mixed, it can be applied to the prepared surface by brush. Brushing is usually best due to the fact that most of the areas to be repaired are small. It is recommended that the patch material not completely cover the roughened area. This permits a field inspector to verify that proper surface preparation was performed before application of the patching material. Practices conducive to a good coating are contained in the technical data sheet for PROTECTO Joint Compound.
5. It is important to coat the entire freshly cut exposed metal surface of the cut pipe end. To ensure proper sealing, overlap at least one inch of the lining with this repair material.

866.DIP.PIPE



PROTECTO 401™

2010 EDITION

P 10

Technical Data

Description

A brushable novalac epoxy designed for sealing cut ends and repairs when pipe are lined with PROTECTO 401 Ceramic Epoxy.

Limitations

This material should be used on spigots and in bell sockets only after the pipe or fitting is lined with PROTECTO 401 Ceramic Epoxy. PROTECTO Joint Compound can be used over PROTECTO 401 or on bare substrate.

NOTE: Do not apply PROTECTO 401 over PROTECTO Joint Compound

Surface Preparation

The surface preparation shall be equal to the specifications for the project or as outlined in the touch-up procedure. Do not apply PROTECTO Joint Compound over wet or frozen surfaces. Dry Film Thickness: As outlined in specifications.

Application Data

Brush, roll or airless spray.


Thin or clean up with Methyl Ethyl Ketone.

Physical Data

Volatile Organic Contents: <1.40 lbs per gallon mixed unthinned.

Safety Data

See individual product label for safety and health data information. Individual Material Safety Data Sheets are available upon request.



Products for Water, Wastewater and Fire Protection

Ductile Iron Pipe	SIZE RANGE
TYTON JOINT® Pipe	4"-64"
Mechanical Joint Pipe	4"-12"
TR FLEX® Pipe	4"-36"
HP LOK™ Restrained Joint Pipe	30"-64"
Flanged Pipe	3"-64"
USIFLEX® Boltless Flexible Ball Joint Pipe	4"-48"
Restrained Joints	
TR FLEX® Pipe	4"-36"
HP LOK™ Restrained Joint Pipe	30"-64"
MJ FIELD LOK® Gaskets	4"-24"
FIELD LOK 350® Gaskets	4"-24"
FIELD LOK® Gasket	30" & 36"
TR FLEX GRIPPER® Rings	4"-36"
TR TELE FLEX® Assemblies	4"-24"
Fittings	
TRIM TYTON® Fittings	4"-12"
TYTON® Fittings	14"-64"
TR FLEX® Fittings and TR FLEX® Telescoping Sleeves	4"-64"
Mechanical Joint Fittings CIO	30"-48"
Flanged Fittings	30"-64"
XTRA FLEX® Couplings	4"-24"
Miscellaneous Products	
PROTECTO 401™ Lined Ductile Iron Pipe for Domestic Sewage and Industrial Wastes	4"-64" Ductile Iron
RING FLANGE-TYTE® Gaskets	4"-36"
FULL FACE FLANGE-TYTE® Gaskets	4"-64"
Polymeric Linings	For all pipe sizes
Saddle Outlets	Various Ductile Iron
Welded Outlets	Various Ductile Iron
Polyethylene Encasement	4"-64"

Our products are manufactured in conformance with National Standards so that our customers may be assured of getting the performance and longevity they expect. Use of accessories or other appurtenances that do not comply with recognized standards may jeopardize the performance and longevity of the project.



*All U.S. Pipe brochures and/or products are
subject to change without further notice.*

P.O. BOX 10406
BIRMINGHAM, AL 35202
866.DIP.PIPE (866.347.7473)
FAX: 205.254.7165
EMAIL: INFO@USPIPE.COM
WWW.USPIPE.COM

**MORE
THAN
JUST
PIPE.**

